

	TRANSFORMER OPEN TYPE
	RUNNING INDICATOR
	FAULT INDICATOR
	PUSH-BUTTON
	NORMALLY OPEN RELAY / CONTACTOR CONTACTS
	NORMALLY CLOSED RELAY / CONTACTOR CONTACTS
	FIELD TERMINALS
	AUTO-OFF-MANUAL PANEL SWITCH
	CIRCUIT BREAKER
	RELAY / CONTACTOR COIL
	OFF-ON PANEL SWITCH
	TIME CLOCK COIL
	ELECTRIC MOTOR 3 PHASE
	FIELD ISOLATOR
	STARTER CONTACTOR + OVERLOAD
	THERMOSTAT IN FIELD
	FIELD SENSOR



DATE	14th Oct 2010	DESIGNED	RR
SCALE	N/A	CHECKED	
DRAWN	RR	No. IN SET	1 of 7

CONTROL & DESIGN PTY LTD
 52 TAYLORS LANE STRATHFIELDSAYE
 TEL. (03) 54393495 FAX. (03) 54395126
 A.C.N. 086998679

PROJECT
 BENDIGO TRADE TRAINING CENTRE SCHOOL
 BENDIGO SENIOR SECONDARY COLLEGE
 BUILDING A MECHANICAL SERVICES

TITLE
 MECHANICAL ELECTRICAL SERVICES
 ELECTRICAL SCHEMATIC BUILDING A

DRAWING No. **C-401E1** REVISION **1**
 CAD FILE No. BSSC TRADE TRAINING/ELEC SCHEMATIC

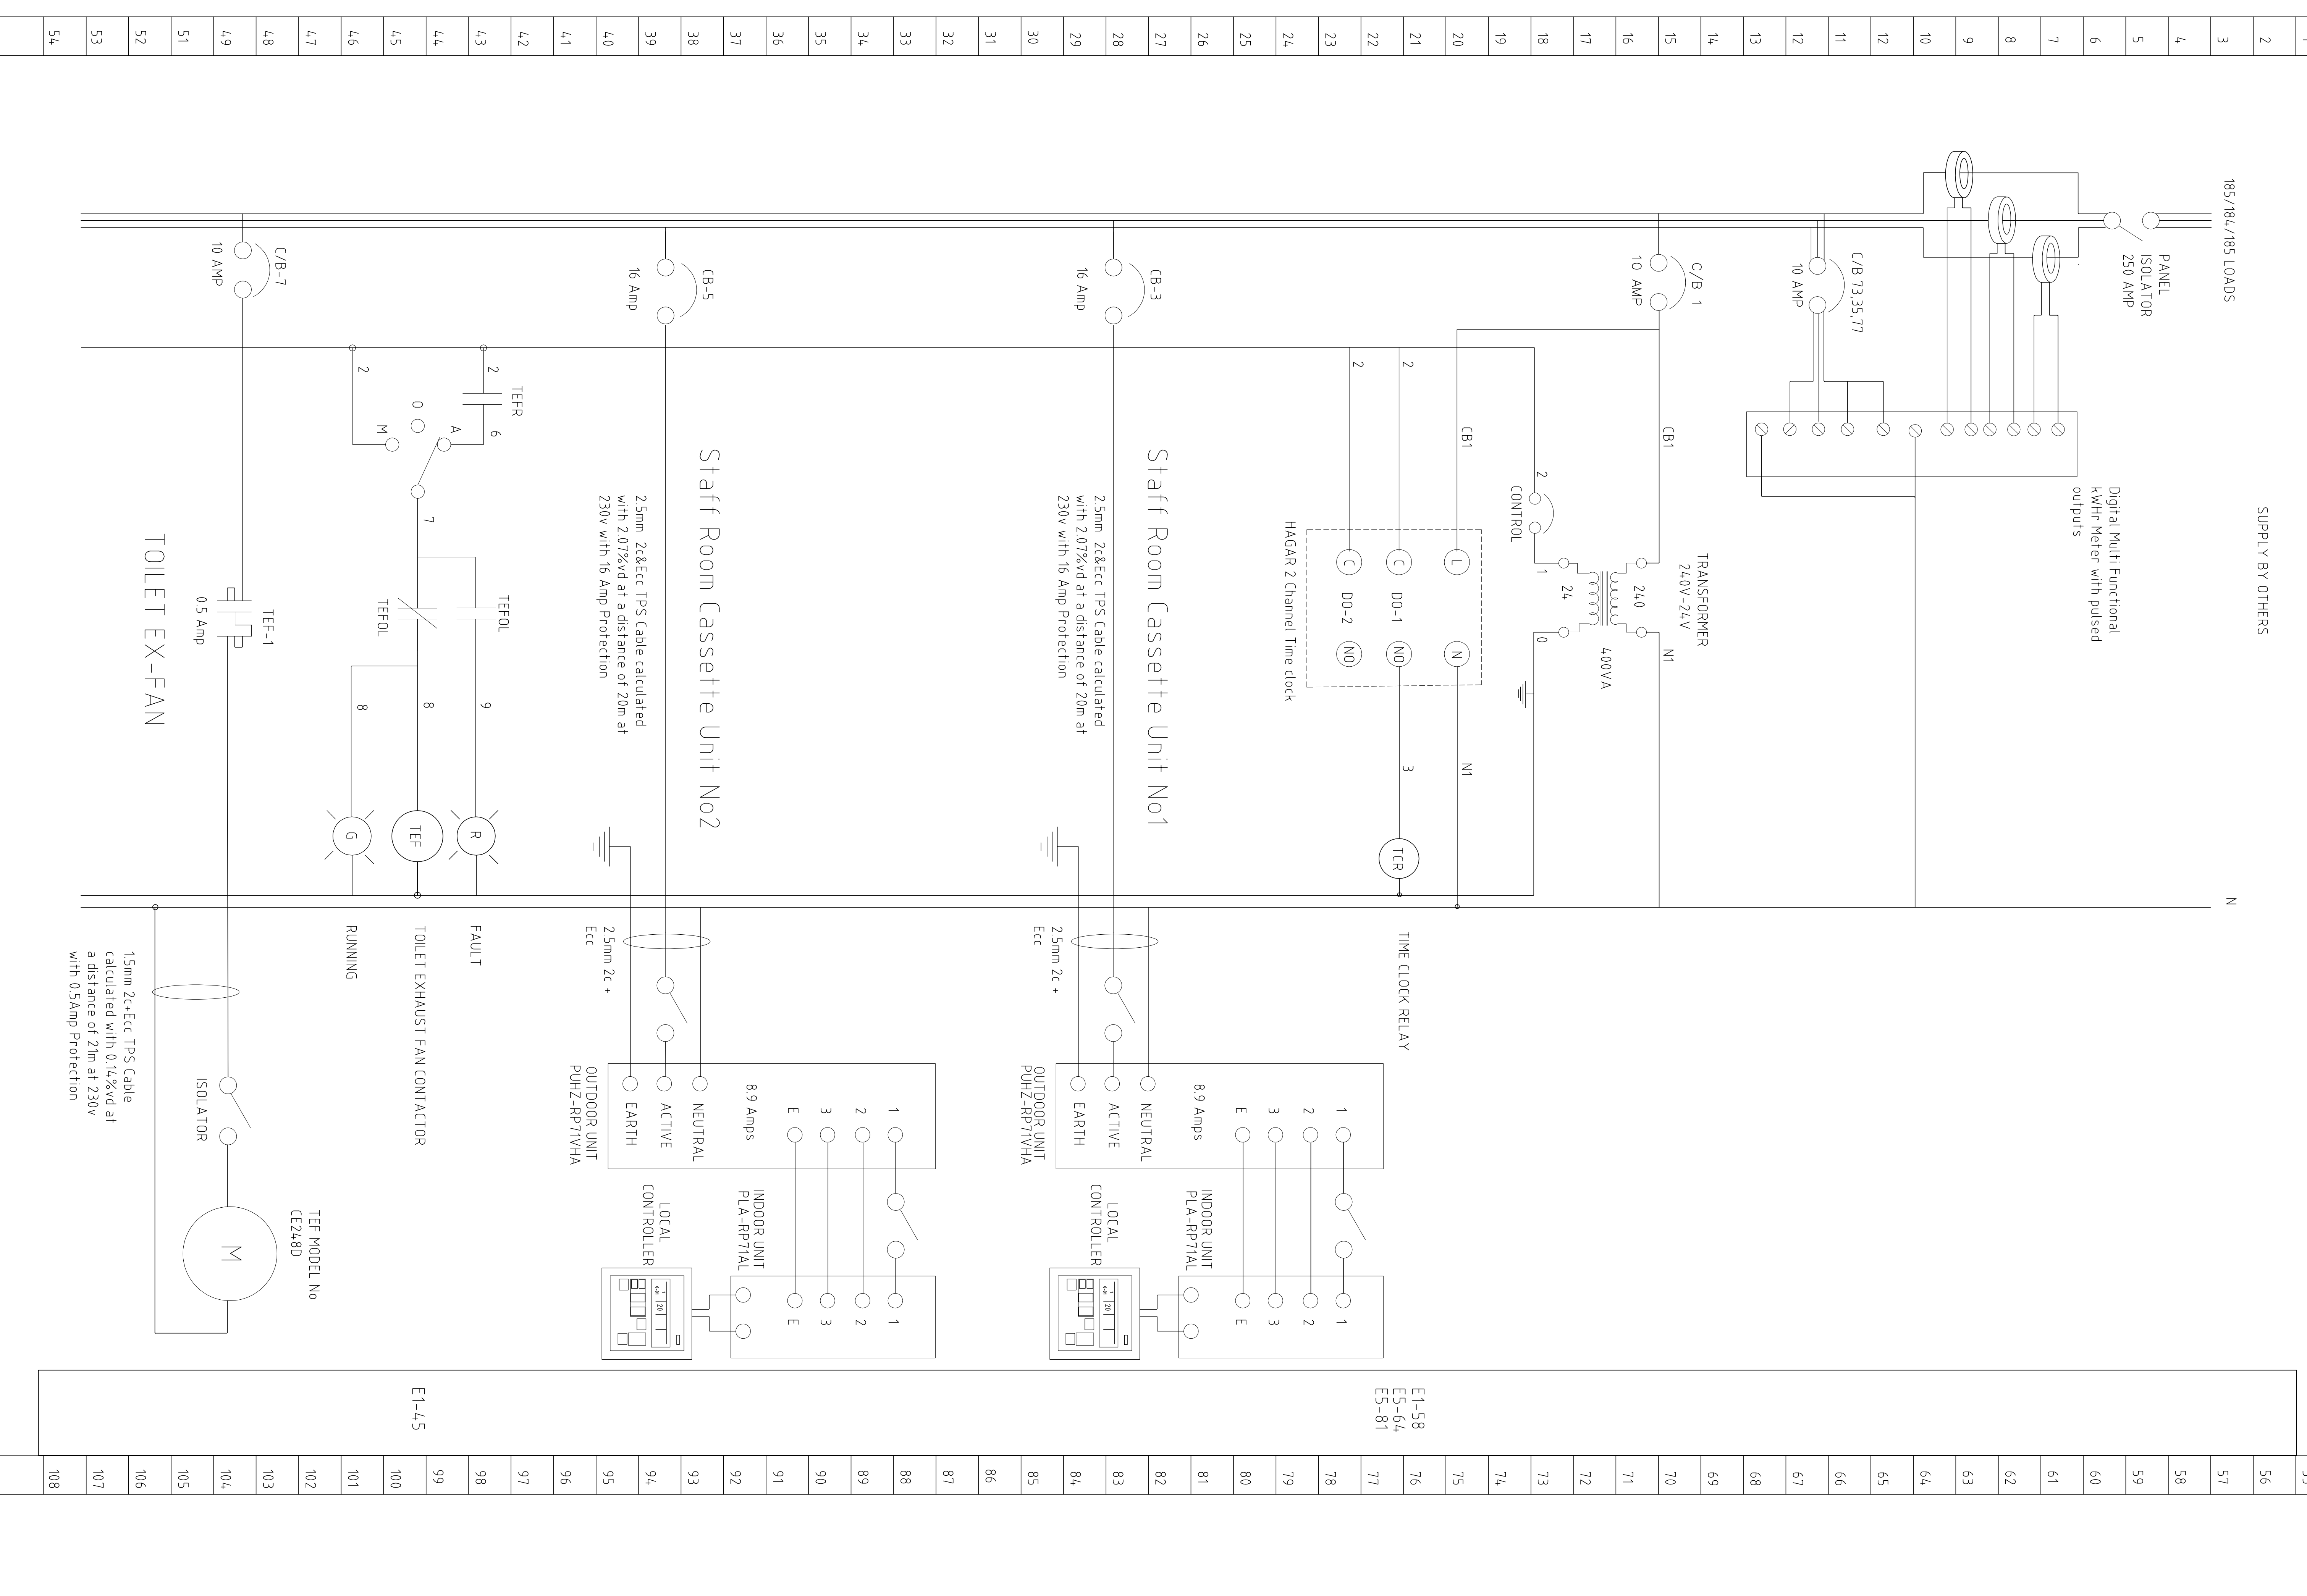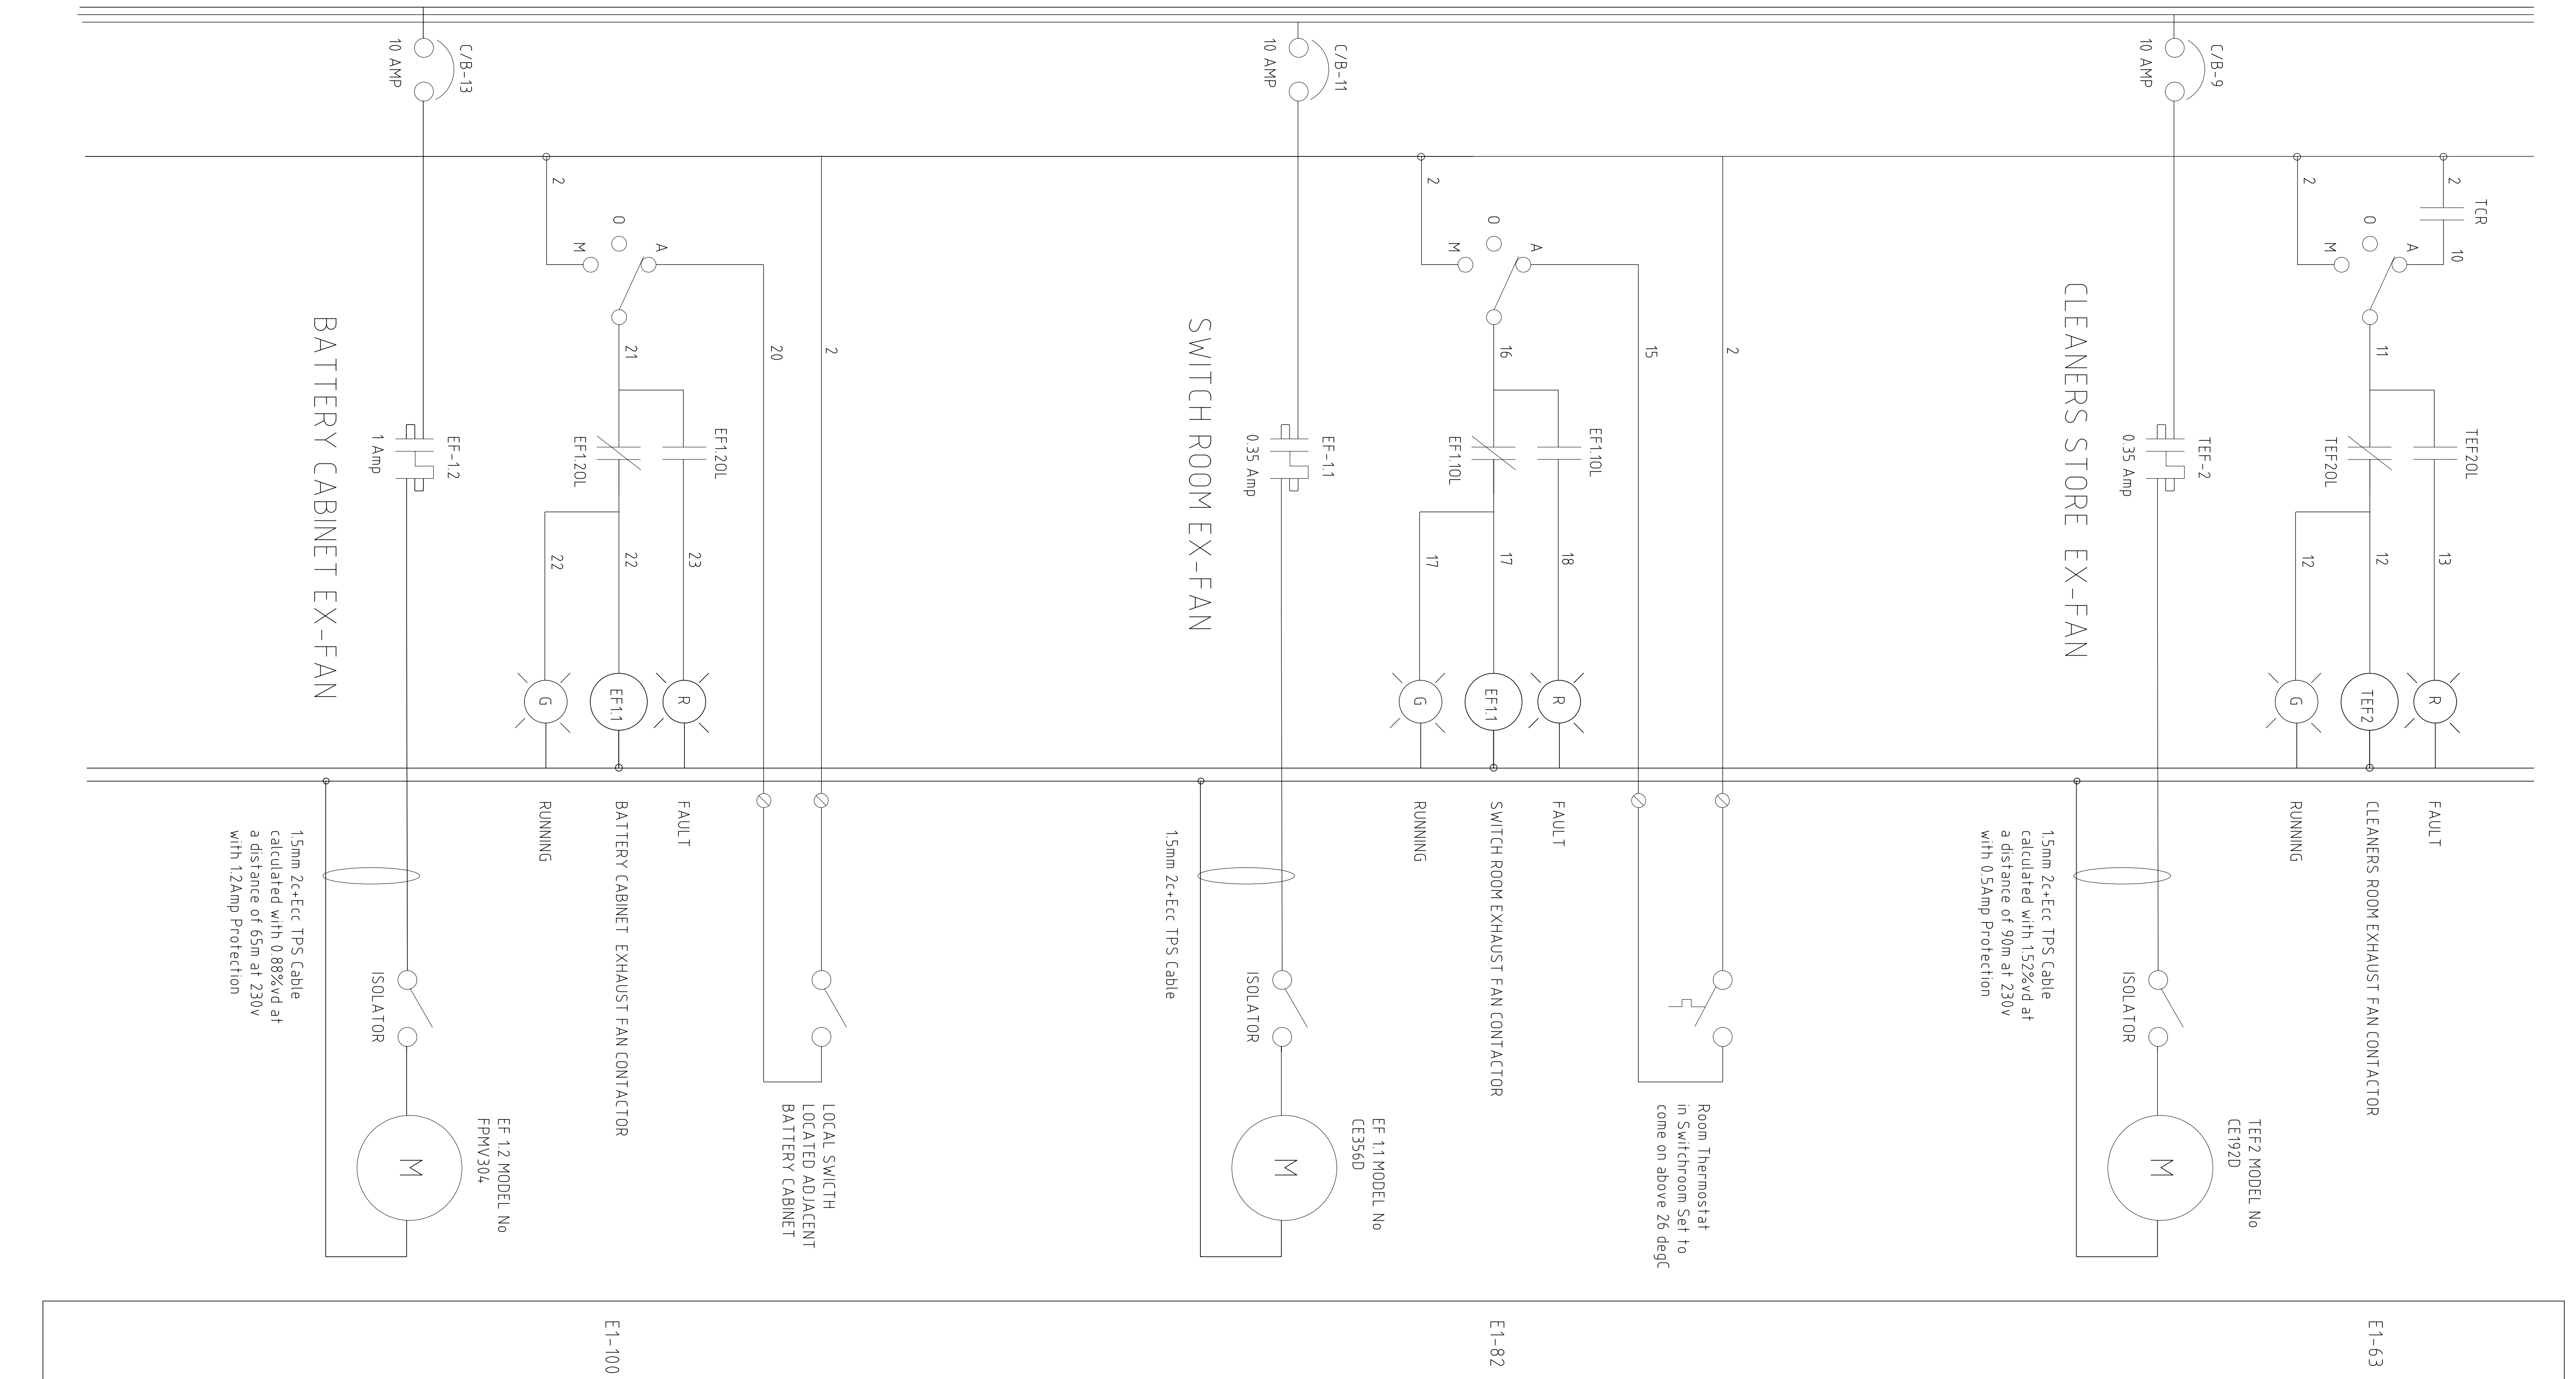

55	
56	
57	
58	
59	
60	
61	
62	
63	
64	
65	
66	
67	
68	
69	
70	
71	
72	
73	
74	
75	
76	
77	
78	
79	
80	
81	
82	
83	
84	
85	
86	
87	
88	
89	
90	
91	
92	
93	
94	
95	
96	
97	
98	
99	
100	
101	
102	
103	
104	
105	
106	
107	
108	

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54

SUPPLY BY OTHERS
 185/186/185 LOADS
 PANEL ISOLATOR 250 AMP
 Digital Multi Functional kWhr Meter with pulsed outputs
 TRANSFORMER 240V-24V
 C/B-1 10 AMP
 C/B-3 16 AMP
 C/B-5 16 AMP
 C/B-7 10 AMP
 C/B-9 10 AMP
 C/B-11 10 AMP
 C/B-13 10 AMP
 C/B-3 16 AMP
 C/B-5 16 AMP
 C/B-7 10 AMP
 C/B-9 10 AMP
 C/B-11 10 AMP
 C/B-13 10 AMP